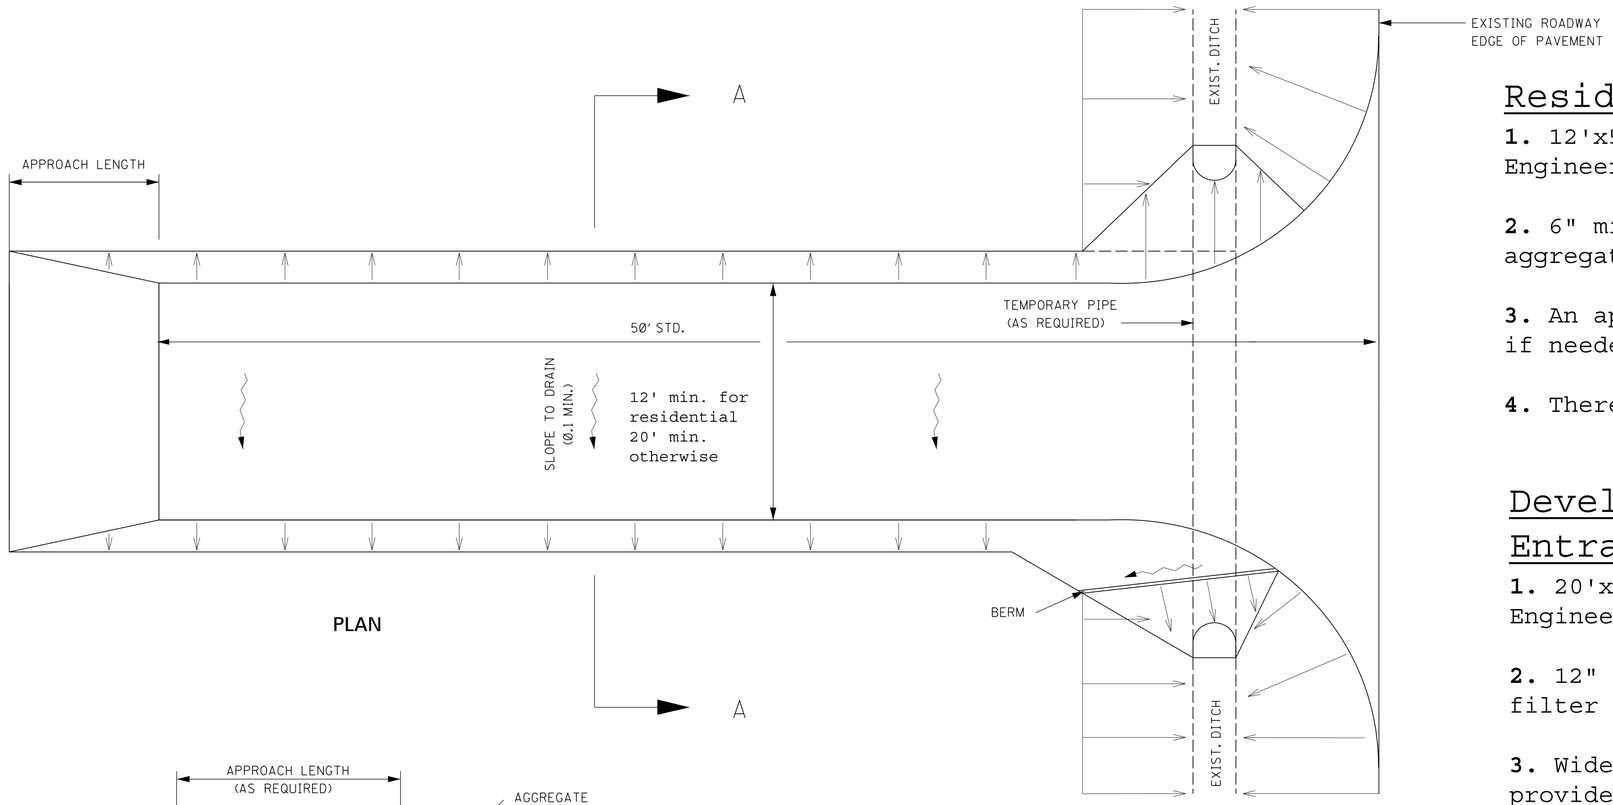

PLAN

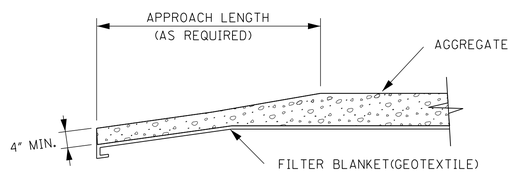

TRANSITION DETAIL

Residential Construction Entrance

1. 12'x50' minimum unless approved by DeSoto County Engineering Department.

2. 6" minimum thickness of 1/2"-1" limestone aggregate (#57 stone) over filter fabric.

3. An appropriately sized culvert must be installed, if needed.

4. There shall be no parking on public roads.

Development/Subdivision Construction Entrance

1. 20'x50' minimum unless approved by Desoto County Engineering Department.

2. 12" minimum thickness 1.5"-3" angular rock over filter fabric.

3. Widen entrance at connection to public road to provide for turning radius of trucks.

4. An appropriately sized culvert must be installed, if needed.

5. There shall be no parking on public roads.

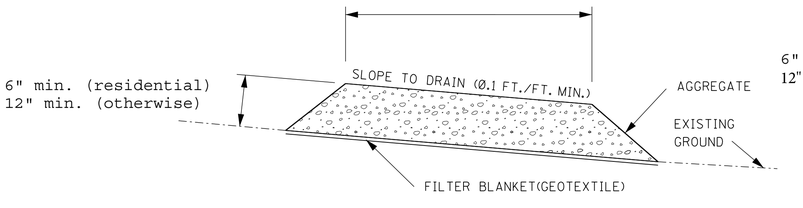

SECTION A–A

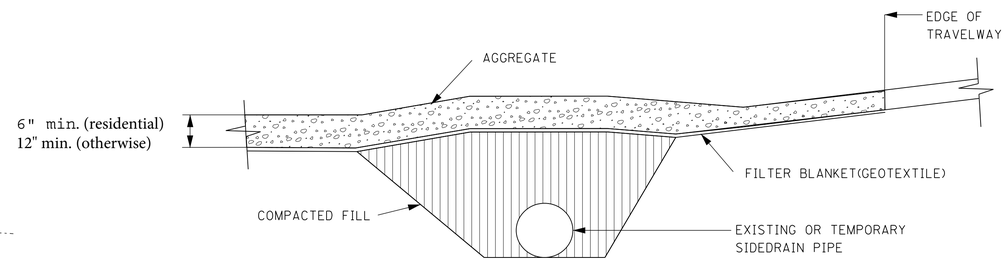

RURAL CONNECTION DETAIL

DATE	REVISION	BY

STABILIZED CONSTRUCTION ENTRANCE

ISSUE DATE: